

Annual Groundwater Monitoring Report

Appalachian Power Company
John E. Amos Plant
Fly Ash Pond CCR Management Unit
Winfield, West Virginia

January 2024

Prepared by:
American Electric Power Service Corporation
1 Riverside Plaza
Columbus, Ohio 43215



An **AEP** Company

BOUNDLESS ENERGYSM

	<u>Table of Contents</u>	<u>Page</u>
I.	Overview.....	1
II.	Groundwater Monitoring Well Locations and Identification Numbers.....	3
III.	Monitoring Wells Installed or Decommissioned	5
IV.	Groundwater Quality Data and Static Water Elevation Data, With Flow Rate and Direction Calculations and Discussion	5
V.	Groundwater Quality Data Statistical Analysis	5
VI.	Alternative Source Demonstration.....	5
VII.	Discussion About Transition Between Monitoring Requirements or Alternate Monitoring Frequency.....	6
VIII.	Other Information Required.....	6
IX.	Description of Any Problems Encountered in 2023 and Actions Taken	6
X.	A Projection of Key Activities for the Upcoming Year.....	6

Appendix 1 – Groundwater Quality Data, Flow Rates, Flow Directions

Appendix 2 – Groundwater Quality Data Statistical Analysis

Appendix 3 – Alternative Source Demonstrations – Not Applicable

Appendix 4 – Transition between Monitoring Programs - Not Applicable

Appendix 5 – Wells Installed or Decommissioned - Not Applicable

Abbreviations:

ASD – Alternate Source Demonstration

CCR – Coal Combustion Residual

GWPS – Groundwater Protection Standard

SSI – Statistically Significant Increase

SSL – Statistically Significant Level

AMFAP – Amos Fly Ash Pond

I. Overview

This *Annual Groundwater Monitoring and Corrective Action Report* (Report) has been prepared to report the status of activities for the preceding year for an existing CCR unit at Appalachian Power Company's, a wholly-owned subsidiary of American Electric Power Company (AEP), John E. Amos Power Plant. The USEPA's CCR rules require that the initial Annual Groundwater Monitoring and Corrective Action Report for inactive surface impoundments be posted to the operating record no later than August 1, 2019 and then annually, thereafter. This Annual Groundwater Monitoring and Corrective Action Report covers all activities required by the CCR Rule for all of 2023.

In general, the following activities were completed:

- The Amos Fly Ash Pond (AMFAP) CCR unit began 2023 in detection monitoring and remained in detection monitoring throughout all of 2023.
- Groundwater data underwent various validation tests, including tests for completeness, valid values, transcription errors, and consistent units.
- The October/November 2022 detection monitoring sampling event resulted in potential statistically significant increase (SSI) for calcium at MW-2, but verification sampling in February 2023 did not confirm the SSI. Statistical analysis of the October/November monitoring event was completed in May 2023.
- The May/June 2023 detection monitoring sampling event resulted in potential statistically significant increase (SSI) for pH at MW-2, but verification sampling in July 2023 did not confirm the SSI. Statistical analysis of the May/June 2023 detection monitoring event was completed in October 2023.
- A detection monitoring sampling event occurred in October 2023. The statistical analysis for this event is not yet complete. A potential SSI was identified for calcium at MW-2, and a resampling event will occur in 2024. If the SSI is confirmed, an ASD will be performed. If the ASD is unsuccessful, the AMFAP will transition into the assessment monitoring program under the CCR Rule.
- Statistics related reports completed in 2023 are included in **Appendix 2**.

The major components of this annual report, to the extent applicable at this time, are presented in sections that follow:

- A map, aerial photograph or a drawing showing the CCR management unit(s), all groundwater monitoring wells and monitoring well identification numbers.
- All of the monitoring data collected, including the rate and direction of groundwater flow, plus a summary showing the number of samples collected per monitoring well, the dates

the samples were collected and whether the sample was collected as part of detection monitoring or assessment monitoring programs (**Appendix 1**).

- Results of the required statistical analysis of groundwater monitoring results (**Appendix 2**).
- Discussion of any alternative source demonstrations completed, if applicable (Appendix 3). This is not applicable to this report.
- A summary of any transition between monitoring programs or an alternate monitoring frequency, for example the date and circumstances for transitioning from detection monitoring to assessment monitoring, in addition to identifying the constituents detected at a statistically significant increase over background concentrations, if applicable (Appendix 4). This is not applicable to this report.
- Identification of any monitoring wells that were installed or decommissioned during the preceding year, along with a statement as to why that happened, if applicable (Appendix 5). This is not applicable to this report.
- Other information required to be included in the annual report such as an alternate monitoring frequency or assessment of corrective measures, if applicable.

In addition, this report summarizes key actions completed, and where applicable, describes any problems encountered and actions taken to resolve those problems. The report includes a projection of key activities for the upcoming year.

II. Groundwater Monitoring Well Locations and Identification Numbers

Figure 1 depicts the PE-certified groundwater monitoring network, the monitoring well locations and their corresponding identification numbers. The groundwater monitoring network has been determined to adequately monitor upgradient, downgradient, and background areas adjacent to the Fly Ash Pond, as detailed in the *Groundwater Monitoring Well Network Evaluation* that was placed on the AEP CCR public internet site on May 1, 2019. The groundwater quality monitoring network includes the following:

- Five upgradient or sidegradient monitoring wells: MW-1807A, MW-1807B, MW-1808A, MW-1809A, and MW-1810A.
- Ten downgradient monitoring wells: MW-1, MW-2, MW-5, MW-6, MW-7, MW-8, MW-9, MW-1801A, MW-1804A, and MW-1806A.

MW-1807B is screened in the Clarksburg shale to provide background groundwater quality in a deeper secondary groundwater-bearing zone that is hydraulically connected to the uppermost aquifer. Since this monitoring well is not located within the uppermost aquifer but in a deeper groundwater bearing zone, it is shown only on the site figure and not included in the groundwater flow direction maps.



Legend

- Orange diamond: Upgradient Sampling Location
- Pink diamond: Downgradient Sampling Location
- Dashed black rectangle: Fly Ash Pond

Notes
- Monitoring well coordinates and site features provided by AEP.

1,000 500 0 1,000
Feet

Site Layout
Fly Ash Pond
AEP Amos Generating Plant
Winfield, West Virginia

Geosyntec
consultants

Figure
1

III. Monitoring Wells Installed or Decommissioned

No monitoring wells were installed or decommissioned in 2023. The network design, as summarized in the *Groundwater Monitoring Well Network Evaluation Report* (2019) and as posted at the CCR website for Amos' Fly Ash Pond, did not change. That network design report, viewable on the AEP CCR website, discussed the facility location, the hydrogeological setting, the hydrostratigraphic units, the uppermost aquifer, downgradient monitoring well locations and the upgradient monitoring well locations.

IV. Groundwater Quality Data and Static Water Elevation Data, With Flow Rate and Direction Calculations and Discussion

Appendix 1 contains the groundwater quality data collected since initiating CCR background sampling through results received in 2023. **Appendix 1** also contains the groundwater velocity and residence time determinations for each completed sampling event, to date. Static water elevation data from each monitoring event are used to develop potentiometric maps and determine the groundwater flow direction for each respective sampling event.

V. Groundwater Quality Data Statistical Analysis

Statistical analysis of the October/November 2022 detection monitoring samples was completed in May 2023. There were no SSI's observed during this event. A potential SSI for calcium at MW-2 was not confirmed with verification sampling in February 2023. The statistical analysis can be found in **Appendix 2**.

Statistical analysis of the May/June 2023 detection monitoring samples was completed in October 2023. There were no SSI's observed during this event. A potential SSI for pH at MW-2 was not confirmed with verification sampling in July 2023. The statistical analysis can be found in **Appendix 2**.

The October 2023 detection monitoring sample results are undergoing statistical analysis. A potential SSI was identified for calcium at MW-2 was identified, and a resampling event will occur in January 2024. If the SSI is confirmed, an ASD will be attempted. If successful, the AMFAP will remain in detection monitoring. However, if unsuccessful, the AMFAP will transition into assessment monitoring.

VI. Alternative Source Demonstration

No alternative source demonstrations were completed in 2023 since no SSIs were identified.

VII. Discussion About Transition Between Monitoring Requirements or Alternate Monitoring Frequency

As of this annual groundwater report date there has been no transition between detection monitoring and assessment monitoring and the CCR Unit remains in detection monitoring. Detection monitoring will continue throughout 2024 pending the results of the aforementioned statistical analysis regarding the October 2023 detection monitoring event. If the statistical analysis confirms any SSIs, an ASD will be performed if applicable. The sampling frequency of twice per year will be maintained for the Appendix III parameters upon a successful alternative source demonstration. If necessary, a transition to the assessment monitoring program will occur.

Regarding defining an alternate monitoring frequency, the groundwater velocity and monitoring well production is high enough at this facility that no modification of the twice-per-year detection monitoring frequency is needed.

VIII. Other Information Required

As required by the CCR detection monitoring rules in 40 CFR 257.94, sampling all CCR wells for the Appendix III parameters was completed in 2012. All required information has been included in this annual groundwater monitoring report.

IX. Description of Any Problems Encountered in 2023 and Actions Taken

No significant problems were encountered. The low flow sampling effort went smoothly and the schedule was met to support the 2023 annual groundwater report preparation.

X. A Projection of Key Activities for the Upcoming Year

Key activities for the upcoming year include:

- Complete the statistical evaluation of the October 2023 second semi-annual detection monitoring results and subsequent verification sampling, looking for any confirmed statistically significant increases.
- Perform an ASD, if necessary, for the October 2023 detection monitoring event if any SSIs are confirmed. If the ASD if necessary and is unsuccessful, the CCR unit will transition into assessment monitoring. If it is successful or no SSIs are confirmed, the CCR unit will continue detection monitoring on a semi-annual basis.
- Respond to any new data received in light of what the CCR rule requires.
- Preparation of the 2024 annual groundwater report.

APPENDIX 1

Tables follow, showing a summary of the number of samples collected per monitoring well and the groundwater monitoring data collected, the groundwater velocity, and the direction of groundwater flow. The dates that the samples were collected also is shown.

Table 1. Groundwater Data Summary: MW-1
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/24/2018	Background	0.182	2.83	11.7	0.42	8.2	30.6	473
8/28/2018	Background	0.135	2.80	11.3	0.45	8.5	31.6	435
10/3/2018	Background	0.138	2.95	11.1	0.40	8.3	30.8	457
10/22/2018	Background	0.180	2.36	11.4	0.42	8.3	30.7	434
11/13/2018	Background	0.209	3.03	11.5	0.45	8.0	32.2	444
12/19/2018	Background	0.117	2.71	10.7	0.43	8.1	30.9	428
1/23/2019	Background	0.115	2.29	14.6	0.41	8.2	55.9	453
2/19/2019	Background	0.126	2.36	10.9	0.44	8.5	31.3	457
3/12/2019	Detection	0.110	2.60	11.0	0.43	8.2	31.6	458
11/8/2019	Detection	0.114	2.38	11.2	0.42	8.2	33.7	461
5/13/2020	Detection	0.122	2.74	11.2	0.42	8.2	33.6	457
11/2/2020	Detection	0.097	2.70	10.5	0.48	8.4	33.6	434
5/5/2021	Detection	0.111	2.65	11.0	0.51	8.3	32.9	448
7/21/2021	Detection	--	--	--	0.49	8.1	--	--
11/10/2021	Detection	0.109	2.31	11.0	0.48	8.2	31.5	440
5/23/2022	Detection	0.108	2.19	10.7	0.48	8.2	33.5	430 L1
10/26/2022	Detection	0.106	2.53	10.5	0.46	8.3	34.2	430
6/1/2023	Detection	0.107	2.25	10.4	0.47	8.1	32.9	430
10/18/2023	Detection	0.101	2.59	10.1	0.46	8.2	32.3	410

Table 1. Groundwater Data Summary: MW-1**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/24/2018	Background	0.02 J1	7.65	52.9	< 0.004 U1	0.008 J1	0.075	0.031	1.086	0.42	0.041	0.012	< 0.002 U1	1.94	< 0.03 U1	0.03 J1
8/28/2018	Background	0.02 J1	7.90	49.5	< 0.004 U1	< 0.005 U1	0.092	0.039	0.261	0.45	0.047	0.009	< 0.002 U1	1.48	< 0.03 U1	0.01 J1
10/3/2018	Background	< 0.02 U1	7.98	51.5	< 0.02 U1	< 0.01 U1	0.1 J1	0.03 J1	1.782	0.40	0.02 J1	< 0.009 U1	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
10/22/2018	Background	< 0.02 U1	6.84	44.7	< 0.02 U1	< 0.01 U1	0.1 J1	0.05 J1	0.608	0.42	0.07 J1	< 0.009 U1	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
11/13/2018	Background	< 0.02 U1	8.04	51.9	< 0.02 U1	< 0.01 U1	0.583	0.03 J1	0.4563	0.45	0.06 J1	< 0.009 U1	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
12/19/2018	Background	0.03 J1	7.65	48.6	< 0.02 U1	< 0.01 U1	0.08 J1	0.03 J1	0.3156	0.43	0.02 J1	0.02 J1	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
1/23/2019	Background	0.06 J1	7.64	43.7	< 0.02 U1	< 0.01 U1	0.09 J1	0.03 J1	0.688	0.41	0.03 J1	< 0.009 U1	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
2/19/2019	Background	0.05 J1	7.83	44.7	< 0.02 U1	< 0.01 U1	0.1 J1	0.03 J1	0.00538	0.44	0.111	0.01 J1	< 0.002 U1	1 J1	0.05 J1	< 0.1 U1

Table 1. Groundwater Data Summary: MW-2
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/27/2018	Background	0.259	4.24	471	3.08	8.4	2.4	1,260
8/29/2018	Background	0.249	3.98	443	2.99	8.6	17.4	1,310
10/4/2018	Background	0.256	4.31	435	2.99	8.5	14.8	1,280
10/23/2018	Background	0.262	3.95	438	3.08	8.5	7.4	1,250
11/15/2018	Background	0.328	4.07	469	3.30	8.5	13.5	1,250
12/19/2018	Background	0.225	3.81	430	3.03	8.5	6.4	1,250
1/23/2019	Background	0.318	3.67	441	3.00	8.2	6.4	1,310
2/20/2019	Background	0.237	3.95	447	3.06	8.7	2.3	1,310
3/13/2019	Detection	0.230	3.98	441	3.02	8.7	1.8	1,300
11/12/2019	Detection	0.265	4.77	426	2.73	8.5	20.1	1,340
2/11/2020	Detection	--	4.31	--	--	8.3	--	--
5/12/2020	Detection	0.214	4.35	443	2.91	8.6	6 J1	1,340
11/2/2020	Detection	0.194	4.13	435	3.24	8.6	6.6	1,310
5/5/2021	Detection	0.230	4.07	480	3.24	8.4	13.1	1,310
11/11/2021	Detection	0.212	4.54	451	3.26	8.4	9.9	1,310
5/24/2022	Detection	0.214	4.44	445	3.01	8.4	13.8	1,290 L1
10/26/2022	Detection	0.220	5.18	450	3.06	8.5	14.9	1,320
2/7/2023	Detection	--	4.65	--	--	8.4	--	--
6/2/2023	Detection	0.20 J1	4.73	454	3.16	7.5	4.5	1,310
7/18/2023	Detection	--	--	--	--	8.4	--	--
10/19/2023	Detection	0.22 M1, J1	5.16 M1	455	3.08	8.4	4.6	1,300

Table 1. Groundwater Data Summary: MW-2**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/27/2018	Background	0.06	1.68	202	0.008 J1	0.02 J1	0.312	0.102	1.354	3.08	0.406	0.019	< 0.002 U1	27.2	0.04 J1	0.02 J1
8/29/2018	Background	0.02 J1	1.62	178	< 0.004 U1	< 0.005 U1	0.129	0.034	1.7	2.99	0.033	0.023	< 0.002 U1	34.5	< 0.03 U1	0.02 J1
10/4/2018	Background	< 0.02 U1	1.76	192	< 0.02 U1	< 0.01 U1	0.2 J1	0.05 J1	1.288	2.99	0.1 J1	< 0.009 U1	< 0.002 U1	30.8	< 0.03 U1	< 0.1 U1
10/23/2018	Background	< 0.02 U1	1.24	181	< 0.02 U1	< 0.01 U1	0.2 J1	0.055	0.594	3.08	0.214	0.03 J1	< 0.002 U1	26.1	< 0.03 U1	< 0.1 U1
11/15/2018	Background	< 0.02 U1	1.66	185	< 0.02 U1	< 0.01 U1	0.2 J1	0.04 J1	0.953	3.30	0.110	0.02 J1	< 0.002 U1	29.2	< 0.03 U1	< 0.1 U1
12/19/2018	Background	0.03 J1	1.33	182	< 0.02 U1	0.03 J1	0.967	0.04 J1	1.058	3.03	0.290	0.02 J1	< 0.002 U1	25.5	< 0.03 U1	< 0.1 U1
1/23/2019	Background	< 0.02 U1	1.55	178	< 0.02 U1	< 0.01 U1	0.382	0.050	0.725	3.00	0.166	0.01 J1	< 0.002 U1	29.2	0.04 J1	< 0.1 U1
2/20/2019	Background	< 0.1 U1	1.35	169	< 0.1 U1	< 0.05 U1	< 0.2 U1	< 0.1 U1	0.2747	3.06	< 0.1 U1	0.02 J1	< 0.002 U1	21.9	< 0.2 U1	< 0.5 U1

Table 1. Groundwater Data Summary: MW-5
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/24/2018	Background	0.252	6.75	793	3.32	8.1	0.2	1,890
8/29/2018	Background	0.240	6.71	780	3.33	8.2	0.2	1,880
10/3/2018	Background	0.276	7.03	776	3.33	8.1	0.1 J1	1,860
10/24/2018	Background	0.249	7.09	811	3.44	8.1	< 0.06 U1	1,840
11/13/2018	Background	0.264	6.79	832	3.63	8.0	0.1 J1	1,880
12/19/2018	Background	0.221	6.48	783	3.43	7.9	< 0.06 U1	1,890
1/23/2019	Background	0.323	5.98	782	3.36	8.1	< 0.06 U1	1,910
2/19/2019	Background	0.239	6.79	793	3.38	8.2	< 0.06 U1	1,920
3/13/2019	Detection	0.229	6.85	804	3.44	8.0	0.08 J1	1,930
11/8/2019	Detection	0.182	21.0	663	3.04	8.0	32.0	1,840
2/11/2020	Detection	--	11.3	713	--	7.8	18.6	--
5/11/2020	Detection	0.211	9.85	746	2.97	7.9	11.0	1,820
7/7/2020	Detection	--	8.77	--	--	8.1	22.8	--
10/27/2020	Detection	0.207	9.50	729	3.24	8.2	25.1	1,770
1/7/2021	Detection	--	9.31	--	--	8.1	14.6	--
5/5/2021	Detection	0.203	7.23	773	3.31	8.1	13.7	1,750
7/21/2021	Detection	--	--	--	--	8.0	45.9	--
11/11/2021	Detection	0.207	11.0	707	3.21	7.9	17.8	1,720
5/23/2022	Detection	0.199	8.57	715	3.12	8.0	12.2	1,690 L1
10/26/2022	Detection	0.201	10.2	781	3.28	8.2	1.3	1,770
5/31/2023	Detection	0.173	7.07	703	3.18	7.9	19.2	1,660
10/19/2023	Detection	0.151	14.9	612	2.84	8.1	37.9	1,620

Table 1. Groundwater Data Summary: MW-5**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/24/2018	Background	0.06	4.89	356	0.004 J1	0.006 J1	0.152	0.046	1.37	3.32	0.222	0.032	< 0.002 U1	36.5	< 0.03 U1	0.05 J1
8/29/2018	Background	0.18	5.08	359	< 0.004 U1	0.01 J1	0.278	0.085	1.805	3.33	0.284	0.030	< 0.002 U1	38.4	< 0.03 U1	0.02 J1
10/3/2018	Background	< 0.02 U1	4.86	373	< 0.02 U1	< 0.01 U1	0.626	0.053	1.63	3.33	0.03 J1	< 0.009 U1	< 0.002 U1	35.7	< 0.03 U1	< 0.1 U1
10/24/2018	Background	0.02 J1	4.34	363	< 0.02 U1	< 0.01 U1	0.219	0.516	0.731	3.44	0.06 J1	0.03 J1	< 0.002 U1	35.1	0.04 J1	< 0.1 U1
11/13/2018	Background	< 0.02 U1	4.37	353	< 0.02 U1	< 0.01 U1	0.1 J1	0.04 J1	1.824	3.63	0.03 J1	0.02 J1	< 0.002 U1	34.7	< 0.03 U1	< 0.1 U1
12/19/2018	Background	< 0.02 U1	4.39	364	< 0.02 U1	< 0.01 U1	0.07 J1	0.04 J1	1.514	3.43	< 0.02 U1	0.03 J1	< 0.002 U1	34.8	< 0.03 U1	< 0.1 U1
1/23/2019	Background	< 0.04 U1	4.35	351	< 0.04 U1	< 0.02 U1	0.532	< 0.04 U1	1.052	3.36	< 0.04 U1	0.02 J1	< 0.002 U1	35.0	< 0.06 U1	< 0.2 U1
2/19/2019	Background	< 0.06 U1	5.25	349	< 0.06 U1	< 0.03 U1	0.2 J1	< 0.06 U1	1.454	3.38	< 0.06 U1	0.034	< 0.002 U1	33.6	< 0.09 U1	< 0.3 U1

Table 1. Groundwater Data Summary: MW-6
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/24/2018	Background	0.120	61.0	19.3	0.22	6.9	44.4	392
8/28/2018	Background	0.096	59.7	19.4	0.24	6.9	44.6	398
10/3/2018	Background	0.125	60.7	18.9	0.21	6.8	43.4	402
10/24/2018	Background	0.1 J1	61.5	18.4	0.23	6.9	42.0	400
11/13/2018	Background	0.111	64.9	19.8	0.24	6.7	44.6	390
12/19/2018	Background	0.07 J1	55.8	17.7	0.23	6.7	41.7	376
1/23/2019	Background	0.08 J1	54.1	17.8	0.22	6.6	41.3	411
2/19/2019	Background	0.09 J1	55.8	17.3	0.24	7.0	40.4	406
3/12/2019	Detection	0.08 J1	57.9	17.4	0.23	6.9	39.8	390
11/8/2019	Detection	0.079	56.6	17.2	0.24	6.9	41.7	368
5/11/2020	Detection	0.088	55.8	15.9	0.25	7.0	32.6	416
10/27/2020	Detection	0.089	53.4	16.5	0.28	7.1	38.6	384
1/7/2021	Detection	--	--	--	0.30	7.1	--	--
5/6/2021	Detection	0.074	49.7	15.4	0.32	6.9	35.8	400
7/21/2021	Detection	--	--	--	0.27	6.8	--	--
11/11/2021	Detection	0.078	52.5 M1, P3	16.0	0.28	6.8	36.6	370
5/24/2022	Detection	0.070	51.8	14.8	0.26	6.9	38.4	360 L1
10/27/2022	Detection	0.073	53.7 M1, P3	15.7	0.26	7.0	39.9	360
5/31/2023	Detection	0.070	46.8	13.7	0.28	6.8	36.6	350
10/19/2023	Detection	0.073	47.3	13.0	0.27	6.9	35.3	350

Table 1. Groundwater Data Summary: MW-6**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/24/2018	Background	0.01 J1	1.81	536	0.009 J1	0.01 J1	0.094	0.242	2.73	0.22	0.02 J1	0.012	< 0.002 U1	0.58	< 0.03 U1	0.03 J1
8/28/2018	Background	0.02 J1	1.82	527	0.008 J1	0.02	0.663	0.323	2.439	0.24	0.167	0.009	< 0.002 U1	0.60	< 0.03 U1	0.02 J1
10/3/2018	Background	< 0.02 U1	1.91	523	< 0.02 U1	0.01 J1	0.09 J1	0.260	4.59	0.21	< 0.02 U1	< 0.009 U1	< 0.002 U1	0.5 J1	< 0.03 U1	< 0.1 U1
10/24/2018	Background	< 0.02 U1	1.72	494	0.03 J1	< 0.01 U1	0.07 J1	0.258	2.202	0.23	0.03 J1	0.01 J1	< 0.002 U1	0.6 J1	< 0.03 U1	< 0.1 U1
11/13/2018	Background	< 0.02 U1	2.12	524	< 0.02 U1	< 0.01 U1	0.08 J1	0.233	2.325	0.24	0.03 J1	< 0.009 U1	< 0.002 U1	0.7 J1	< 0.03 U1	< 0.1 U1
12/19/2018	Background	< 0.02 U1	1.88	510	< 0.02 U1	0.01 J1	0.06 J1	0.234	2.53	0.23	0.02 J1	0.01 J1	< 0.002 U1	0.7 J1	< 0.03 U1	< 0.1 U1
1/23/2019	Background	0.04 J1	1.89	486	< 0.02 U1	< 0.01 U1	0.04 J1	0.220	1.82	0.22	< 0.02 U1	< 0.009 U1	< 0.002 U1	0.6 J1	< 0.03 U1	< 0.1 U1
2/19/2019	Background	< 0.02 U1	1.53	482	< 0.02 U1	< 0.01 U1	0.277	0.219	2.136	0.24	< 0.02 U1	0.02 J1	< 0.002 U1	0.6 J1	0.04 J1	< 0.1 U1

Table 1. Groundwater Data Summary: MW-7
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/26/2018	Background	0.087	1.33	5.41	0.27	8.5	32.0	368
8/29/2018	Background	0.112	1.29	5.32	0.27	8.8	31.5	387
10/3/2018	Background	0.156	1.44	5.23	0.26	8.8	31.8	376
10/24/2018	Background	0.09 J1	1.40	5.37	0.27	8.8	31.7	344
11/13/2018	Background	0.192	1.49	5.65	0.29	8.4	33.2	379
12/17/2018	Background	0.1 J1	1.24	5.29	0.27	8.6	32.0	387
1/23/2019	Background	0.127	1.41	5.18	0.25	8.4	32.0	389
2/18/2019	Background	0.06 J1	1.37	5.39	0.26	9.0	32.1	401
3/12/2019	Detection	0.06 J1	1.47	5.49	0.27	8.9	32.5	385
11/11/2019	Detection	0.066	2.18	5.36	0.25	8.7	32.3	390
2/11/2020	Detection	--	1.39	--	--	8.5	--	--
5/11/2020	Detection	0.067	1.59	5.30	0.27	8.4	23.6	395
10/28/2020	Detection	0.065	1.81	5.34	0.31	8.9	31.2	387
1/6/2021	Detection	--	1.53	--	0.31	9.0	--	--
5/12/2021	Detection	0.055	1.46	5.45	0.30	8.8	31.1	401
11/10/2021	Detection	0.058	1.57	5.50	0.27	8.6	29.9	390
5/20/2022	Detection	0.060	1.62	5.42	0.29	8.7	32.0	400 L1
10/25/2022	Detection	0.065	1.84	5.44	0.28	8.7	32.5	400
6/1/2023	Detection	0.05 J1	1.61	5.40	0.24	8.4	30.9	380
10/19/2023	Detection	0.05 J1	1.68	5.34	0.24	8.5	30.1	390

Table 1. Groundwater Data Summary: MW-7**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/26/2018	Background	0.04 J1	5.31	34.0	< 0.004 U1	0.01 J1	0.082	0.038	1.958	0.27	0.211	0.009	< 0.002 U1	1.12	< 0.03 U1	0.01 J1
8/29/2018	Background	0.05 J1	5.51	32.3	< 0.004 U1	0.01 J1	0.190	0.023	0.745	0.27	0.121	0.010	< 0.002 U1	1.06	< 0.03 U1	0.02 J1
10/3/2018	Background	0.07 J1	5.65	33.9	< 0.02 U1	< 0.01 U1	0.07 J1	< 0.02 U1	2.391	0.26	0.111	< 0.009 U1	< 0.002 U1	1 J1	0.03 J1	< 0.1 U1
10/24/2018	Background	0.18	5.13	37.0	< 0.02 U1	0.02 J1	0.296	0.134	0.1126	0.27	0.476	< 0.009 U1	< 0.002 U1	1 J1	0.05 J1	< 0.1 U1
11/13/2018	Background	0.12	5.24	32.7	< 0.02 U1	< 0.01 U1	0.1 J1	0.03 J1	0.9538	0.29	0.146	< 0.009 U1	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
12/17/2018	Background	0.06 J1	5.21	33.5	< 0.02 U1	< 0.01 U1	0.1 J1	< 0.02 U1	1.236	0.27	0.1 J1	< 0.009 U1	< 0.002 U1	1 J1	0.04 J1	< 0.1 U1
1/23/2019	Background	0.44	5.86	36.8	< 0.02 U1	0.02 J1	0.221	0.068	0.558	0.25	0.420	< 0.009 U1	< 0.002 U1	1 J1	0.05 J1	< 0.1 U1
2/18/2019	Background	0.27	5.33	34.3	0.03 J1	0.02 J1	0.1 J1	0.057	0.543	0.26	0.230	0.01 J1	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1

Table 1. Groundwater Data Summary: MW-8
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/26/2018	Background	0.233	2.15	--	--	--	--	--
8/2/2018	Background	--	--	105	2.70	8.2	21.6	690
8/30/2018	Background	0.225	1.99	109	2.66	8.9	24.2	727
10/3/2018	Background	0.259	2.74	108	2.58	7.9	31.6	729
10/23/2018	Background	0.278	2.32	108	2.74	8.5	26.3	717
11/13/2018	Background	0.254	2.46	116	2.93	8.2	27.2	711
12/18/2018	Background	0.224	2.28	110	2.78	8.5	26.4	696
1/23/2019	Background	0.213	2.39	111	2.62	8.1	30.1	739
2/20/2019	Background	0.195	2.49	111	2.87	9.2	26.4	740
3/12/2019	Detection	0.192	2.32	110	2.87	8.5	27.4	716
11/8/2019	Detection	0.197	1.98	109	2.97	8.3	22.5	717
5/12/2020	Detection	0.191	1.83	108	2.73	7.3	19.9	720
10/26/2020	Detection	0.215	8.47	508	3.07	8.4	37.4	1,400
1/7/2021	Detection	--	2.46	107	--	8.2	18.3	729
5/7/2021	Detection	0.180	2.19	109	2.99	8.5	20.2	711
11/10/2021	Detection	0.191	2.28	107	2.97	8.6	15.8	700
5/20/2022	Detection	0.179	2.11	106	2.91	8.5	21.7	710 L1
10/26/2022	Detection	0.192	2.34	108	3.03	8.5	21.7	700
6/1/2023	Detection	0.17 J1	2.12	107	2.95	8.3	22.3	710
10/19/2023	Detection	0.171	2.25	108	2.88	8.4	21.0	690

Table 1. Groundwater Data Summary: MW-8**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/26/2018	Background	0.04 J1	3.02	63.7	0.005 J1	< 0.005 U1	0.114	0.210	1.5625	--	0.237	0.013	< 0.002 U1	11.7	0.05 J1	0.02 J1
8/2/2018	Background	--	--	--	--	--	--	--	--	2.70	--	--	--	--	--	--
8/30/2018	Background	0.85	5.71	58.2	0.049	0.05	1.89	1.69	0.655	2.66	2.78	0.012	0.004 J1	20.6	0.2	0.076
10/3/2018	Background	0.20	5.18	86.2	< 0.02 U1	0.02 J1	0.2 J1	0.270	3.981	2.58	0.427	< 0.009 U1	< 0.002 U1	8.76	0.08 J1	< 0.1 U1
10/23/2018	Background	0.15	4.26	70.9	< 0.02 U1	< 0.01 U1	0.229	0.284	0.294	2.74	0.491	0.02 J1	< 0.002 U1	10.2	0.08 J1	< 0.1 U1
11/13/2018	Background	0.14	3.49	71.5	< 0.02 U1	< 0.01 U1	0.2 J1	0.253	0.691	2.93	0.352	< 0.009 U1	< 0.002 U1	7.64	0.08 J1	< 0.1 U1
12/18/2018	Background	0.26	2.91	73.3	< 0.02 U1	< 0.01 U1	0.264	0.231	0.956	2.78	0.357	0.02 J1	< 0.002 U1	6.93	0.1 J1	< 0.1 U1
1/23/2019	Background	0.27	3.49	76.8	< 0.02 U1	< 0.01 U1	0.463	0.513	0.3857	2.62	0.990	< 0.009 U1	< 0.002 U1	11.0	0.09 J1	< 0.1 U1
2/20/2019	Background	0.4 J1	2.41	71.9	< 0.1 U1	< 0.05 U1	0.4 J1	0.538	0.736	2.87	0.770	0.009 J1	< 0.002 U1	8 J1	0.4 J1	< 0.5 U1

Table 1. Groundwater Data Summary: MW-9
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/26/2018	Background	0.157	1.03	--	--	--	--	--
8/2/2018	Background	--	--	7.22	0.87	8.3	12.9	421
8/30/2018	Background	0.128	1.04	7.21	0.86	8.0	12.2	468
10/2/2018	Background	0.145	1.44	7.60	0.83	7.1	12.6	513
10/23/2018	Background	0.141	1.07	7.26	0.87	9.3	12.8	460
11/13/2018	Background	0.166	1.24	7.29	0.91	9.1	11.9	449
12/19/2018	Background	--	--	--	--	9.2	--	--
12/20/2018	Background	0.114	1.03	7.11	0.84	--	15.7	435
1/22/2019	Background	--	--	--	--	9.7	--	--
1/23/2019	Background	0.134	1.01	7.45	0.77	--	20.1	484
2/19/2019	Background	--	--	--	--	9.2	--	--
2/20/2019	Background	0.128	1.26	7.70	0.84	--	28.5	505
3/12/2019	Detection	0.122	1.18	7.50	0.91	9.0	24.0	463
11/8/2019	Detection	0.133	1.02	7.72	0.83	8.8	19.1	440
5/13/2020	Detection	0.122	0.959	7.27	0.82	9.0	12.0	459
10/29/2020	Detection	0.128	1.44	6.93	0.90	7.1	11.1	459
5/5/2021	Detection	--	--	--	--	9.0	--	--
5/6/2021	Detection	0.109	1.01	7.08	0.92	--	14.4	448
11/11/2021	Detection	0.122	1.11	7.26	0.91	8.8	14.5	450
5/20/2022	Detection	0.118	1.03	7.45	0.90	9.0	15.4	460 L1
10/25/2022	Detection	0.135	1.07	7.15	0.87	9.1	14.3	450
6/2/2023	Detection	0.12 J1	1.07	7.26	0.88	8.9	14.3	460
10/19/2023	Detection	0.12 J1	1.03	6.89	0.89	9.0	11.8	430

Table 1. Groundwater Data Summary: MW-9**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/26/2018	Background	0.21	5.23	46.8	0.004 J1	0.01 J1	0.218	1.00	0.912	--	1.12	0.010	< 0.002 U1	7.31	0.06 J1	0.060
8/2/2018	Background	--	--	--	--	--	--	--	--	0.87	--	--	--	--	--	--
8/30/2018	Background	0.91	5.87	46.8	0.02 J1	0.35	1.17	2.15	1.162	0.86	5.23	0.010	0.012	6.28	0.2	0.209
10/2/2018	Background	0.59	7.04	66.0	0.192	0.07	4.52	3.70	0.543	0.83	8.66	0.009 J1	0.016	6.07	0.9	0.4 J1
10/23/2018	Background	1.28	4.58	45.4	0.08 J1	0.02 J1	1.90	1.39	0.658	0.87	2.68	0.01 J1	0.008	5.93	0.4	0.3 J1
11/13/2018	Background	0.35	5.83	51.1	0.115	0.02 J1	2.54	1.92	0.635	0.91	3.44	< 0.009 U1	0.004 J1	6.06	0.6	0.2 J1
12/20/2018	Background	0.33	4.47	35.8	< 0.02 U1	0.10	0.725	0.393	0.847	0.84	1.03	< 0.009 U1	0.010	6.51	0.4	0.1 J1
1/23/2019	Background	1.08	5.84	44.6	0.09 J1	0.03 J1	2.46	1.43	1.464	0.77	2.45	< 0.009 U1	0.009	6.49	0.5	0.2 J1
2/20/2019	Background	0.4 J1	5.45	41.5	< 0.1 U1	< 0.05 U1	0.7 J1	0.349	0.2514	0.84	0.955	0.01 J1	0.006	6 J1	0.3 J1	< 0.5 U1

Table 1. Groundwater Data Summary: MW-1801A
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/24/2018	Background	0.274	62.5	9.64	0.1 J1	7.6	49.4	372
8/29/2018	Background	0.288	64.0	10.8	0.11	7.4	54.8	420
10/2/2018	Background	0.137	61.0	7.48	0.1 J1	7.4	46.7	356
10/24/2018	Background	0.105	63.1	8.14	0.1 J1	7.5	41.8	357
11/14/2018	Background	0.236	65.4	9.86	0.1 J1	7.3	49.3	386
12/19/2018	Background	0.289	62.8	9.08	0.12	7.3	45.5	361
1/24/2019	Background	0.168	53.4	9.18	0.14	6.3	46.3	365
2/20/2019	Background	0.09 J1	53.3	8.96	0.13	8.0	40.0	343
3/12/2019	Detection	0.09 J1	51.2	9.40	0.16	7.5	41.7	306
11/11/2019	Detection	0.229	61.6	9.76	0.12	7.4	45.3	385
5/13/2020	Detection	0.105	52.6	9.93	0.13	7.6	34.6	353
11/4/2020	Detection	0.244	62.4	8.84	0.12	7.3	41.5	385
5/6/2021	Detection	0.090	56.4	6.75	0.12	7.1	30.5	304
11/8/2021	Detection	0.162	58.1	8.81	0.15	7.3	36.8	360
5/23/2022	Detection	0.068	61.8	7.84	0.10	7.2	33.7	310 L1
10/27/2022	Detection	0.137	59.0	8.15	0.10	7.4	38.3	350
6/1/2023	Detection	0.068	62.3	7.65	0.08	7.0	32.7	330
10/19/2023	Detection	0.147 M1	56.8 M1	7.49	0.10	7.2	34.9	330

Table 1. Groundwater Data Summary: MW-1801A**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L	µg/L
7/24/2018	Background	0.13	0.36	54.4	< 0.004 U1	0.01 J1	0.113	0.194	0.602	0.1 J1	0.042	0.009	< 0.002 U1	4.97	0.09 J1	0.04 J1
8/29/2018	Background	0.05 J1	0.57	56.5	< 0.004 U1	< 0.005 U1	0.143	0.260	1.222	0.11	0.024	0.007	< 0.002 U1	3.07	0.05 J1	0.04 J1
10/2/2018	Background	0.14	0.82	47.1	< 0.02 U1	< 0.01 U1	0.09 J1	0.422	0.254	0.1 J1	0.04 J1	0.02 J1	< 0.002 U1	4.79	0.1 J1	< 0.1 U1
10/24/2018	Background	0.06 J1	0.72	51.3	< 0.02 U1	< 0.01 U1	0.08 J1	0.380	0.654	0.1 J1	0.02 J1	0.009 J1	< 0.002 U1	2.08	0.2 J1	< 0.1 U1
11/14/2018	Background	0.08 J1	1.01	51.3	< 0.02 U1	0.03 J1	0.08 J1	0.414	0.6902	0.1 J1	0.05 J1	< 0.009 U1	< 0.002 U1	2.34	0.1 J1	< 0.1 U1
12/19/2018	Background	0.04 J1	1.11	56.0	< 0.02 U1	0.02 J1	0.1 J1	0.349	0.836	0.12	0.03 J1	0.01 J1	< 0.002 U1	2.77	0.09 J1	< 0.1 U1
1/24/2019	Background	0.06 J1	1.57	55.3	< 0.02 U1	< 0.01 U1	0.07 J1	0.326	0.595	0.14	< 0.02 U1	< 0.009 U1	< 0.002 U1	2.22	0.1 J1	< 0.1 U1
2/20/2019	Background	0.09 J1	1.52	56.6	< 0.02 U1	< 0.01 U1	0.1 J1	0.290	0.588	0.13	< 0.02 U1	< 0.009 U1	< 0.002 U1	3.57	0.2 J1	< 0.1 U1

Table 1. Groundwater Data Summary: MW-1804A
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/27/2018	Background	0.672	28.1	--	--	--	--	--
8/1/2018	Background	--	--	3.87	0.70	7.4	35.2	423
8/28/2018	Background	0.779	15.9	5.27	0.84	8.3	44.7	452
10/2/2018	Background	0.629	38.8	3.63	0.61	7.9	35.7	458
10/23/2018	Background	0.675	12.9	4.79	0.78	7.6	36.9	452
11/13/2018	Background	0.846	8.90	5.32	0.91	7.8	46.0	498
12/19/2018	Background	0.772	10.1	4.51	0.78	7.9	40.1	433
1/24/2019	Background	0.673	12.1	3.14	0.71	7.4	32.3	414
2/20/2019	Background	0.611	7.43	3.29	0.89	8.0	33.8	461
3/12/2019	Detection	0.568	10.2	3.55	0.85	7.9	34.0	411
11/11/2019	Detection	0.730	6.77	11.2	0.64	8.0	85.4	582
2/12/2020	Detection	--	--	9.59	--	7.8	69.0	--
5/14/2020	Detection	0.739	4.51	6.20	0.85	8.1	51.4	484
11/2/2020	Detection	0.549	4.70	7.12	0.86	8.0	57.0	517
1/6/2021	Detection	--	--	9.72	--	8.2	69.3	--
5/6/2021	Detection	0.565	3.98	10.6	0.97	8.1	57.3	533
7/20/2021	Detection	--	--	6.22	--	7.8	47.3	--
11/8/2021	Detection	0.628	5.35	9.80	0.84	8.0	61.1	550
5/20/2022	Detection	0.869	4.60	6.20	0.84	7.9	48.6	480 L1
10/27/2022	Detection	0.759	6.04	7.39	0.79	8.3	49.2	520
6/1/2023	Detection	0.72	5.18	10.4	0.82	7.9	58.1	550
10/19/2023	Detection	0.82	7.08	12.5	0.76	7.7	68.8	590

Table 1. Groundwater Data Summary: MW-1804A**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/27/2018	Background	0.54	2.48	245	0.008 J1	< 0.005 U1	0.185	0.458	1.814	--	0.445	0.018	< 0.002 U1	136	1.8	0.069
8/1/2018	Background	--	--	--	--	--	--	--	--	0.70	--	--	--	--	--	--
8/28/2018	Background	0.15	3.59	204	< 0.004 U1	< 0.005 U1	0.304	0.314	1.559	0.84	0.031	0.015	< 0.002 U1	136	0.2	0.05 J1
10/2/2018	Background	0.53	2.35	390	< 0.02 U1	< 0.01 U1	0.1 J1	0.693	1.664	0.61	0.05 J1	0.032	< 0.002 U1	111	3.1	< 0.1 U1
10/23/2018	Background	0.18	3.36	131	< 0.02 U1	< 0.01 U1	0.1 J1	0.137	0.444	0.78	0.114	0.01 J1	< 0.002 U1	116	0.7	< 0.1 U1
11/13/2018	Background	0.09 J1	4.16	135	< 0.02 U1	< 0.01 U1	0.2 J1	0.160	0.523	0.91	0.133	0.02 J1	< 0.002 U1	129	0.2	< 0.1 U1
12/19/2018	Background	0.13	4.00	169	< 0.02 U1	< 0.01 U1	0.1 J1	0.176	1.089	0.78	0.111	0.01 J1	< 0.002 U1	130	0.5	< 0.1 U1
1/24/2019	Background	0.30	3.32	183	< 0.02 U1	< 0.01 U1	0.2 J1	0.137	1.424	0.71	0.140	< 0.009 U1	< 0.002 U1	110	1.7	< 0.1 U1
2/20/2019	Background	0.19	4.48	116	< 0.02 U1	< 0.01 U1	0.2 J1	0.096	0.894	0.89	0.219	< 0.009 U1	< 0.002 U1	115	0.6	< 0.1 U1

Table 1. Groundwater Data Summary: MW-1806A
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/27/2018	Background	0.164	12.9	--	--	--	--	--
8/1/2018	Background	--	--	17.7	0.56	7.6	48.4	426
8/29/2018	Background	0.162	12.0	16.2	0.55	8.0	45.6	445
10/2/2018	Background	0.150	5.81	7.21	0.80	8.5	36.2	435
10/23/2018	Background	0.158	7.43	8.62	0.77	8.4	40.8	423
11/13/2018	Background	0.213	7.51	8.15	0.85	8.1	40.1	442
12/19/2018	Background	0.162	5.14	5.29	0.85	8.5	30.9	409
1/24/2019	Background	0.168	12.2	11.7	0.59	8.1	48.1	445
2/18/2019	Background	0.133	5.67	6.24	0.81	8.6	33.0	460
3/12/2019	Detection	0.130	4.98	5.51	0.83	8.8	32.9	430
11/12/2019	Detection	0.156	13.5	11.1	0.48	7.9	42.8	423
5/15/2020	Detection	0.127	2.32	8.45	0.86	8.8	35.2	456
10/29/2020	Detection	0.153	7.38	10.2	0.85	8.7	49.7	480
5/6/2021	Detection	0.123	2.01	8.82	0.95	9.0	33.8	449
11/10/2021	Detection	0.127	2.31	10.5	0.91	8.9	34.5	450
5/23/2022	Detection	0.136	2.66	10.7	0.87	8.9	37.4	450 L1
10/27/2022	Detection	0.138	3.48	11.5	0.87	8.9	38.4	440
6/1/2023	Detection	0.12 J1	3.04	13.1	0.87	8.8	40.5	450
10/19/2023	Detection	0.120	3.02	14.2	0.84	8.7	41.2	450

Table 1. Groundwater Data Summary: MW-1806A**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/27/2018	Background	1.16	2.65	163	0.01 J1	0.01 J1	0.416	0.240	0.998	--	0.368	0.012	< 0.002 U1	17.0	0.1	0.03 J1
8/1/2018	Background	--	--	--	--	--	--	--	--	0.56	--	--	--	--	--	--
8/29/2018	Background	0.89	3.29	148	< 0.004 U1	0.008 J1	1.54	0.161	1.533	0.55	0.154	0.010	< 0.002 U1	14.2	0.09 J1	0.02 J1
10/2/2018	Background	0.28	5.30	65.4	< 0.02 U1	< 0.01 U1	0.1 J1	0.080	0.9	0.80	0.158	0.02 J1	< 0.002 U1	7.73	0.07 J1	< 0.1 U1
10/23/2018	Background	0.19	5.16	88.3	< 0.02 U1	< 0.01 U1	0.252	0.152	0.469	0.77	0.195	0.02 J1	< 0.002 U1	6.66	0.07 J1	< 0.1 U1
11/13/2018	Background	0.11	5.91	98.7	< 0.02 U1	< 0.01 U1	0.1 J1	0.163	0.3442	0.85	0.137	< 0.009 U1	< 0.002 U1	7.44	0.05 J1	< 0.1 U1
12/19/2018	Background	0.17	5.65	65.6	< 0.02 U1	< 0.01 U1	0.1 J1	0.071	0.8606	0.85	0.122	< 0.009 U1	< 0.002 U1	6.02	0.06 J1	< 0.1 U1
1/24/2019	Background	0.15	3.97	168	< 0.02 U1	< 0.01 U1	0.08 J1	0.159	1.164	0.59	0.06 J1	0.02 J1	< 0.002 U1	5.62	0.04 J1	< 0.1 U1
2/18/2019	Background	0.1 J1	4.21	78.8	< 0.02 U1	< 0.01 U1	0.2 J1	0.050	0.419	0.81	0.110	0.01 J1	< 0.002 U1	4.74	0.03 J1	< 0.1 U1

Table 1. Groundwater Data Summary: MW-1807A
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/26/2018	Background	0.170	146	9.57	0.21	7.5	334	929
8/28/2018	Background	0.137	136	11.8	0.21	6.9	356	953
10/4/2018	Background	0.129	166	12.5	0.16	6.7	367	985
10/24/2018	Background	0.199	144	10.3	0.20	6.9	308	838
11/14/2018	Background	0.175	155	10.5	0.21	6.8	326	904
12/20/2018	Background	0.208	151	9.68	0.19	7.2	315	931
1/25/2019	Background	0.183	156	11.3	0.15	8.2	361	876
2/21/2019	Background	0.08 J1	150	12.0	0.14	7.2	396	1,050
3/14/2019	Detection	0.09 J1	160	11.1	0.15	6.7	363	1,020
11/11/2019	Detection	0.074	173	11.9	0.13	6.9	392	1,070
5/12/2020	Detection	0.088	159	10.8	0.12	6.7	358	1,040
10/28/2020	Detection	0.069	170	12.4	0.13	7.0	392	1,020
5/6/2021	Detection	0.082	153	10.2	0.17	6.8	328	936
11/11/2021	Detection	0.106	166	9.90	0.15	6.9	336	960
5/26/2022	Detection	0.089	164 M1, P3	10.9	0.15	6.8	363	1,020 L1
10/31/2022	Detection	--	--	--	--	6.9	--	--
11/1/2022	Detection	0.2 J1	164	10.3	0.15	--	333	1,000
6/1/2023	Detection	< 0.1 U1	159	11.5	0.12	6.6	391	1,050
10/25/2023	Detection	0.13 M1, J1	154 M1	9.69	0.16	6.9	291	880

Table 1. Groundwater Data Summary: MW-1807A**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/26/2018	Background	0.13	0.99	32.6	0.006 J1	0.02	0.098	0.629	1.366	0.21	0.046	0.020	< 0.002 U1	1.65	0.3	0.03 J1
8/28/2018	Background	0.87	1.13	32.6	0.005 J1	0.06	0.253	0.565	1.507	0.21	0.300	0.018	0.002 J1	9.07	0.6	0.054
10/4/2018	Background	0.14	1.10	30.1	< 0.02 U1	0.05 J1	0.205	0.918	1.127	0.16	0.142	< 0.009 U1	< 0.002 U1	11.1	0.2 J1	< 0.1 U1
10/24/2018	Background	0.18	0.84	27.8	< 0.02 U1	0.03 J1	0.2 J1	0.579	0.38891	0.20	0.105	0.02 J1	< 0.002 U1	2 J1	0.2 J1	< 0.1 U1
11/14/2018	Background	0.17	0.96	28.8	< 0.02 U1	0.03 J1	0.09 J1	0.614	0.985	0.21	0.09 J1	0.01 J1	< 0.002 U1	2 J1	0.2	< 0.1 U1
12/20/2018	Background	0.17	0.94	29.5	< 0.02 U1	0.03 J1	0.403	0.616	1.016	0.19	0.251	0.02 J1	< 0.002 U1	1 J1	0.3	< 0.1 U1
1/25/2019	Background	0.12	0.92	27.4	< 0.02 U1	0.03 J1	0.1 J1	0.733	1.269	0.15	0.126	0.030	< 0.002 U1	1 J1	0.1 J1	< 0.1 U1
2/21/2019	Background	0.08 J1	0.82	24.1	< 0.02 U1	0.03 J1	0.1 J1	0.811	0.735	0.14	0.118	0.01 J1	< 0.002 U1	0.6 J1	0.1 J1	< 0.1 U1

Table 1. Groundwater Data Summary: MW-1807B
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/26/2018	Background	0.195	8.76	8.46	0.75	8.3	218	732
8/28/2018	Background	0.178	8.39	10.8	1.13	8.1	219	706
10/5/2018	Background	0.201	9.21	9.94	1.01	7.9	219	752
10/24/2018	Background	0.176	8.92	7.93	0.81	8.3	220	735
11/14/2018	Background	0.211	8.87	8.52	0.91	7.7	230	732
12/20/2018	Background	0.164	11.6	9.88	1.16	8.2	230	738
1/25/2019	Background	0.277	9.33	7.68	0.79	6.9	227	742
2/21/2019	Background	0.168	11.0	9.53	1.06	8.4	238	791
3/14/2019	Detection	0.163	12.7	10.8	1.19	7.9	249	793
11/11/2019	Detection	0.189	12.7	13.3	1.40	8.0	247	807
5/13/2020	Detection	0.170	8.70	10.5	1.13	7.7	224	783
11/2/2020	Detection	0.079	168	10.9	0.18	6.7	343	1,020
5/11/2021	Detection	0.182	8.93	12.3	1.46	7.8	193	787
11/11/2021	Detection	0.189	9.21	14.7	1.78	8.0	179	780
5/25/2022	Detection	0.208	9.77	14.9	1.73	7.8	176	780 L1
10/27/2022	Detection	0.194	10.0	13.3	1.42	7.7	192	770
6/1/2023	Detection	0.19 J1	7.46	13.2	1.77	7.9	162	760
10/24/2023	Detection	0.2 J1	9.3	12.1	1.78	7.9	153	790 S7

Table 1. Groundwater Data Summary: MW-1807B**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/26/2018	Background	0.27	1.93	49.6	0.049	0.01 J1	1.40	0.525	0.719	0.75	0.756	0.021	< 0.002 U1	4.22	0.3	0.03 J1
8/28/2018	Background	0.23	1.94	56.3	< 0.004 U1	< 0.005 U1	0.134	0.046	1.31	1.13	0.035	0.010	< 0.002 U1	23.9	0.08 J1	0.01 J1
10/5/2018	Background	0.15	1.70	59.6	0.03 J1	< 0.01 U1	0.263	0.179	2.079	1.01	0.310	< 0.009 U1	< 0.002 U1	12.5	0.2 J1	< 0.1 U1
10/24/2018	Background	0.25	1.26	42.3	< 0.02 U1	< 0.01 U1	0.381	0.139	0.305	0.81	0.203	0.02 J1	< 0.002 U1	5.59	0.07 J1	< 0.1 U1
11/14/2018	Background	0.16	1.28	41.4	< 0.02 U1	< 0.01 U1	0.247	0.073	0.348	0.91	0.08 J1	0.02 J1	< 0.002 U1	5.62	0.05 J1	< 0.1 U1
12/20/2018	Background	0.43	1.75	73.7	< 0.02 U1	< 0.01 U1	0.335	0.114	0.2672	1.16	0.145	0.02 J1	< 0.002 U1	13.5	0.1 J1	< 0.1 U1
1/25/2019	Background	0.09 J1	1.23	43.0	< 0.02 U1	< 0.01 U1	0.08 J1	0.05 J1	1.003	0.79	0.04 J1	0.02 J1	< 0.002 U1	4.21	0.06 J1	< 0.1 U1
2/21/2019	Background	0.35	1.48	66.9	< 0.02 U1	< 0.01 U1	0.1 J1	0.051	0.291	1.06	0.04 J1	< 0.009 U1	< 0.002 U1	9.27	0.08 J1	< 0.1 U1

Table 1. Groundwater Data Summary: MW-1808A
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/25/2018	Background	0.182	40.4	19.6	0.52	7.7	184	734
8/28/2018	Background	0.142	38.5	19.4	0.57	7.6	227	740
10/4/2018	Background	0.135	38.6	16.7	0.41	7.4	216	790
10/24/2018	Background	0.103	41.5	17.1	0.55	7.7	126	614
11/13/2018	Background	0.152	40.2	18.4	0.51	7.4	210	770
12/20/2018	Background	0.172	40.3	21.6	0.47	7.6	242	834
1/25/2019	Background	0.173	47.4	18.3	0.40	6.1	231	840
2/21/2019	Background	0.122	39.4	17.4	0.40	7.2	213	821
3/14/2019	Detection	0.112	62.9	20.9	0.33	7.7	290	912
11/11/2019	Detection	0.131	29.3	17.1	0.45	7.6	235	887
5/13/2020	Detection	0.124	69.6	23.3	0.29	7.0	321	1,010
11/3/2020	Detection	0.119	54.3	25.6	0.44	7.2	300	1,050
5/7/2021	Detection	0.152	28.7	25.0	0.53	7.2	276	1,070
11/11/2021	Detection	0.126	50.1	19.4	0.48	7.1	221	840
5/25/2022	Detection	0.143	76.7	31.9	0.33	7.1	352	1,100 L1
10/28/2022	Detection	0.158	71.8	30.7	0.31	7.0	380	1,140
6/1/2023	Detection	0.14 J1	34.2	27.6	0.38	7.2	274	980
10/19/2023	Detection	0.11 J1	47.2	17.5	0.34	7.3	165	700

Table 1. Groundwater Data Summary: MW-1808A**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/25/2018	Background	0.29	2.47	86.2	0.299	0.007 J1	0.831	0.544	1.892	0.52	2.28	0.024	0.006	6.46	0.5	0.04 J1
8/28/2018	Background	0.14	5.34	105	0.251	0.01 J1	1.25	0.821	4.96	0.57	2.06	0.025	0.005 J1	11.7	0.4	0.083
10/4/2018	Background	0.14	2.84	78.1	0.05 J1	< 0.01 U1	0.500	0.231	2.082	0.41	0.392	< 0.009 U1	< 0.002 U1	4.56	0.07 J1	< 0.1 U1
10/24/2018	Background	0.03 J1	1.86	86.2	0.05 J1	< 0.01 U1	0.443	0.117	1.04	0.55	0.397	0.02 J1	< 0.002 U1	3.06	0.07 J1	< 0.1 U1
11/13/2018	Background	0.04 J1	3.83	74.1	0.03 J1	< 0.01 U1	0.381	0.160	0.47	0.51	0.245	0.02 J1	0.002 J1	2.75	0.05 J1	< 0.1 U1
12/20/2018	Background	0.05 J1	4.37	71.0	0.04 J1	< 0.01 U1	0.293	0.119	1.048	0.47	0.227	0.03 J1	0.003 J1	2 J1	0.08 J1	< 0.1 U1
1/25/2019	Background	0.06 J1	2.27	80.3	0.102	< 0.01 U1	0.415	0.149	2.76	0.40	0.717	0.035	< 0.002 U1	1 J1	0.2 J1	< 0.1 U1
2/21/2019	Background	0.02 J1	1.99	78.9	0.05 J1	< 0.01 U1	0.213	0.076	0.535	0.40	0.316	0.01 J1	< 0.002 U1	1 J1	0.09 J1	< 0.1 U1

Table 1. Groundwater Data Summary: MW-1809A
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/26/2018	Background	0.085	173	26.1	0.16	7.2	386	1,020
8/28/2018	Background	0.091	179	28.8	0.17	7.1	386	1,020
10/3/2018	Background	0.09 J1	191	26.8	0.14	7.1	388	1,070
10/23/2018	Background	0.114	181	26.6	0.14	7.1	390	1,050
11/14/2018	Background	0.09 J1	188	28.4	0.16	7.2	403	1,050
12/19/2018	Background	0.06 J1	182	27.7	0.15	7.0	384	1,040
1/25/2019	Background	0.08 J1	188	28.1	0.14	5.1	390	1,080
2/20/2019	Background	0.08 J1	184	30.2	0.14	7.2	403	1,080
3/12/2019	Detection	0.05 J1	189	31.0	0.14	7.2	396	1,090
11/8/2019	Detection	0.096	195	37.6	0.15	7.0	393	1,110
5/13/2020	Detection	0.081	179	34.9	0.11	7.3	400	1,100
11/5/2020	Detection	0.055	196	33.8	0.13	6.9	391	1,100
5/6/2021	Detection	0.062	182	34.8	0.14	7.1	384	1,090
11/11/2021	Detection	0.063	195	36.6	0.11	7.0	391	1,090
5/24/2022	Detection	0.071	202	36.6	0.12	7.0	375	1,080 L1
10/28/2022	Detection	0.058	203	39.3	0.12	6.9	409	1,090
5/31/2023	Detection	0.071	180	37.5	0.11	7.0	384	1,060
10/19/2023	Detection	0.052	176	35.1	0.11	7.0	391	1,060

Table 1. Groundwater Data Summary: MW-1809A**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L	µg/L
7/26/2018	Background	0.05	2.30	60.2	0.004 J1	< 0.005 U1	0.119	0.555	1.561	0.16	0.035	0.020	< 0.002 U1	7.18	0.04 J1	0.01 J1
8/28/2018	Background	0.03 J1	2.83	67.3	0.004 J1	< 0.005 U1	0.200	0.754	1.193	0.17	0.01 J1	0.024	< 0.002 U1	3.01	0.06 J1	0.02 J1
10/3/2018	Background	0.03 J1	2.87	61.4	< 0.02 U1	< 0.01 U1	0.1 J1	0.533	4.22	0.14	< 0.02 U1	< 0.009 U1	< 0.002 U1	2.27	0.05 J1	< 0.1 U1
10/23/2018	Background	< 0.02 U1	2.59	53.0	< 0.02 U1	< 0.01 U1	0.09 J1	0.424	1.501	0.14	< 0.02 U1	0.043	< 0.002 U1	2 J1	0.03 J1	< 0.1 U1
11/14/2018	Background	< 0.02 U1	3.10	58.0	< 0.02 U1	< 0.01 U1	0.08 J1	0.447	1.717	0.16	< 0.02 U1	0.01 J1	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
12/19/2018	Background	< 0.02 U1	3.51	63.4	< 0.02 U1	< 0.01 U1	0.212	0.504	1.417	0.15	< 0.02 U1	0.032	< 0.002 U1	2.88	< 0.03 U1	< 0.1 U1
1/25/2019	Background	< 0.02 U1	3.39	57.2	< 0.02 U1	< 0.01 U1	0.06 J1	0.375	2.99	0.14	< 0.02 U1	0.046	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
2/20/2019	Background	< 0.1 U1	4.57	64.5	< 0.1 U1	< 0.05 U1	< 0.2 U1	0.559	1.56	0.14	< 0.1 U1	0.038	< 0.002 U1	2 J1	< 0.2 U1	< 0.5 U1

Table 1. Groundwater Data Summary: MW-1810A
Amos - FAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	SU	mg/L	mg/L
7/26/2018	Background	0.220	23.0	--	--	--	--	--
8/2/2018	Background	--	--	23.4	0.93	7.4	170	565
8/27/2018	Background	0.271	25.9	21.6	0.93	7.5	129	525
10/3/2018	Background	0.245	28.0	19.0	0.89	7.3	114	542
10/24/2018	Background	0.211	23.7	18.6	0.86	7.7	93.1	473
11/13/2018	Background	0.238	30.2	19.5	1.04	7.3	160	544
12/20/2018	Background	0.210	30.1	17.0	0.98	7.1	160	548
1/23/2019	Background	0.319	24.8	16.3	0.90	7.5	112	494
2/20/2019	Background	0.245	32.3	15.4	1.01	7.4	170	580
3/12/2019	Detection	0.228	30.5	15.4	1.00	7.3	153	548
11/8/2019	Detection	0.249	44.5	15.2	0.94	7.1	256	692
5/12/2020	Detection	0.226	67.5	17.2	0.78	7.4	379	993
11/3/2020	Detection	0.194	53.7	15.8	0.91	7.0	341	802
5/6/2021	Detection	0.207	64.0	17.3	0.87	7.2	373	935
11/11/2021	Detection	0.230	59.3	15.4	0.83	7.2	283	770
5/24/2022	Detection	0.230	87.1	17.6	0.80	7.1	386	940 L1
10/28/2022	Detection	0.210	52.4 M1	15.7	0.88	7.3	270	730
5/31/2023	Detection	0.213	60.6	15.5	0.91	7.1	295	790
10/19/2023	Detection	0.212	43.5	14.0	0.81	7.3	200	640

Table 1. Groundwater Data Summary: MW-1810A**Amos - FAP****Appendix IV Constituents**

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
7/26/2018	Background	0.13	0.88	124	0.009 J1	< 0.005 U1	0.442	0.150	0.382	--	0.149	0.018	< 0.002 U1	9.26	0.06 J1	0.051
8/2/2018	Background	--	--	--	--	--	--	--	--	0.93	--	--	--	--	--	--
8/27/2018	Background	0.10	0.51	83.4	< 0.004 U1	< 0.005 U1	0.229	0.048	0.842	0.93	0.057	0.015	< 0.002 U1	8.52	0.04 J1	0.02 J1
10/3/2018	Background	0.11	0.49	83.0	< 0.02 U1	< 0.01 U1	0.2 J1	0.03 J1	1.218	0.89	0.09 J1	< 0.009 U1	< 0.002 U1	7.06	0.05 J1	< 0.1 U1
10/24/2018	Background	0.07 J1	0.54	88.5	< 0.02 U1	< 0.01 U1	0.1 J1	0.02 J1	0.992	0.86	0.03 J1	0.02 J1	< 0.002 U1	6.28	0.04 J1	< 0.1 U1
11/13/2018	Background	0.09 J1	0.40	83.5	< 0.02 U1	< 0.01 U1	0.1 J1	0.02 J1	0.24	1.04	0.04 J1	< 0.009 U1	< 0.002 U1	6.03	0.03 J1	< 0.1 U1
12/20/2018	Background	0.08 J1	0.43	87.9	< 0.02 U1	< 0.01 U1	0.1 J1	0.03 J1	0.5648	0.98	0.05 J1	0.02 J1	< 0.002 U1	5.24	0.03 J1	< 0.1 U1
1/23/2019	Background	0.07 J1	0.45	84.2	< 0.02 U1	< 0.01 U1	0.08 J1	0.02 J1	0.768	0.90	0.03 J1	0.01 J1	< 0.002 U1	5.94	0.03 J1	< 0.1 U1
2/20/2019	Background	< 0.1 U1	0.4 J1	87.8	< 0.1 U1	< 0.05 U1	0.3 J1	< 0.1 U1	0.65	1.01	0.1 J1	0.02 J1	< 0.002 U1	4 J1	< 0.2 U1	< 0.5 U1

**Table 1. Groundwater Data Summary
Amos - Fly Ash Pond**

Geosyntec Consultants, Inc.

Notes:

--: Not analyzed

<: Non-detect value. Analytes which were not detected are shown as less than the method detection limit (MDL) followed by a 'U1' flag.

In analytical data prior to 5/18/2021, U1 flags were reported as U in the analytical report.

J1: Concentration estimated. Analyte was detected between the method detection limit and the reporting limit.

L1: The associated laboratory control sample (LCS) or laboratory control sample duplicate (LCSD) recovery was outside acceptance limits.

M1: The associated matrix spike (MS) or matrix spike duplicate (MSD) recovery was outside acceptance limits.

P3: The precision on the matrix spike duplicate (MSD) was above acceptance limits.

S7: Sample did not achieve constant weight.

In analytical data prior to 5/18/2021, J1 flags were reported as J in the analytical report.

mg/L: milligrams per liter

pCi/L: picocuries per liter

SU: standard unit

µg/L: micrograms per liter

**Table 2: Residence Time Calculation Summary
Amos Fly Ash Pond**

Geosyntec Consultants, Inc.


CCR Management Unit	Monitoring Well	Well Diameter (inches)	2023-02 ^[3]		2023-05		2023-07 ^[3]		2023-10	
			Groundwater Velocity (ft/year)	Groundwater Residence Time (days)	Groundwater Velocity (ft/year)	Groundwater Residence Time (days)	Groundwater Velocity (ft/year)	Groundwater Residence Time (days)	Groundwater Velocity (ft/year)	Groundwater Residence Time (days)
Fly Ash Pond	MW-1801A ^[1]	2.0	3.9	15.6	4.0	15.2	0.5	122.5	3.4	18.1
	MW-1804A ^[1]	2.0	25.5	2.4	25.3	2.4	25.6	2.4	15.9	3.8
	MW-1806A ^[1]	2.0	12.1	5.0	13.0	4.7	11.8	5.1	10.2	5.9
	MW-1807A ^[2]	2.0	7.7	7.9	8.9	6.8	7.5	8.2	6.3	9.6
	MW-1808A ^[2]	2.0	36.0	1.7	37.5	1.6	30.3	2.0	35.6	1.7
	MW-1809A ^[2]	2.0	11.0	5.5	10.9	5.6	12.3	5.0	33.0	1.8
	MW-1810A ^[2]	2.0	36.5	1.7	36.1	1.7	31.7	1.9	22.9	2.7
	MW-1 ^[1]	2.0	18.0	3.4	16.9	3.6	16.8	3.6	55.7	1.1
	MW-2 ^[1]	2.0	14.7	4.1	15.0	4.1	15.5	3.9	16.0	3.8
	MW-5 ^[1]	2.0	22.7	2.7	22.2	2.7	22.1	2.8	21.8	2.8
	MW-6 ^[1]	2.0	16.4	3.7	15.6	3.9	15.3	4.0	63.9	1.0
	MW-7 ^[1]	2.0	6.1	9.9	8.4	7.2	5.5	11.1	2.6	23.5
	MW-8 ^[1]	2.0	12.9	4.7	16.4	3.7	15.4	4.0	9.8	6.2
	MW-9 ^[1]	2.0	13.6	4.5	16.2	3.8	13.1	4.6	6.6	9.2

Notes:

[1] - Downgradient Well

[2] - Upgradient/Sidegradient Well

[3] - Two-of-two verification sampling

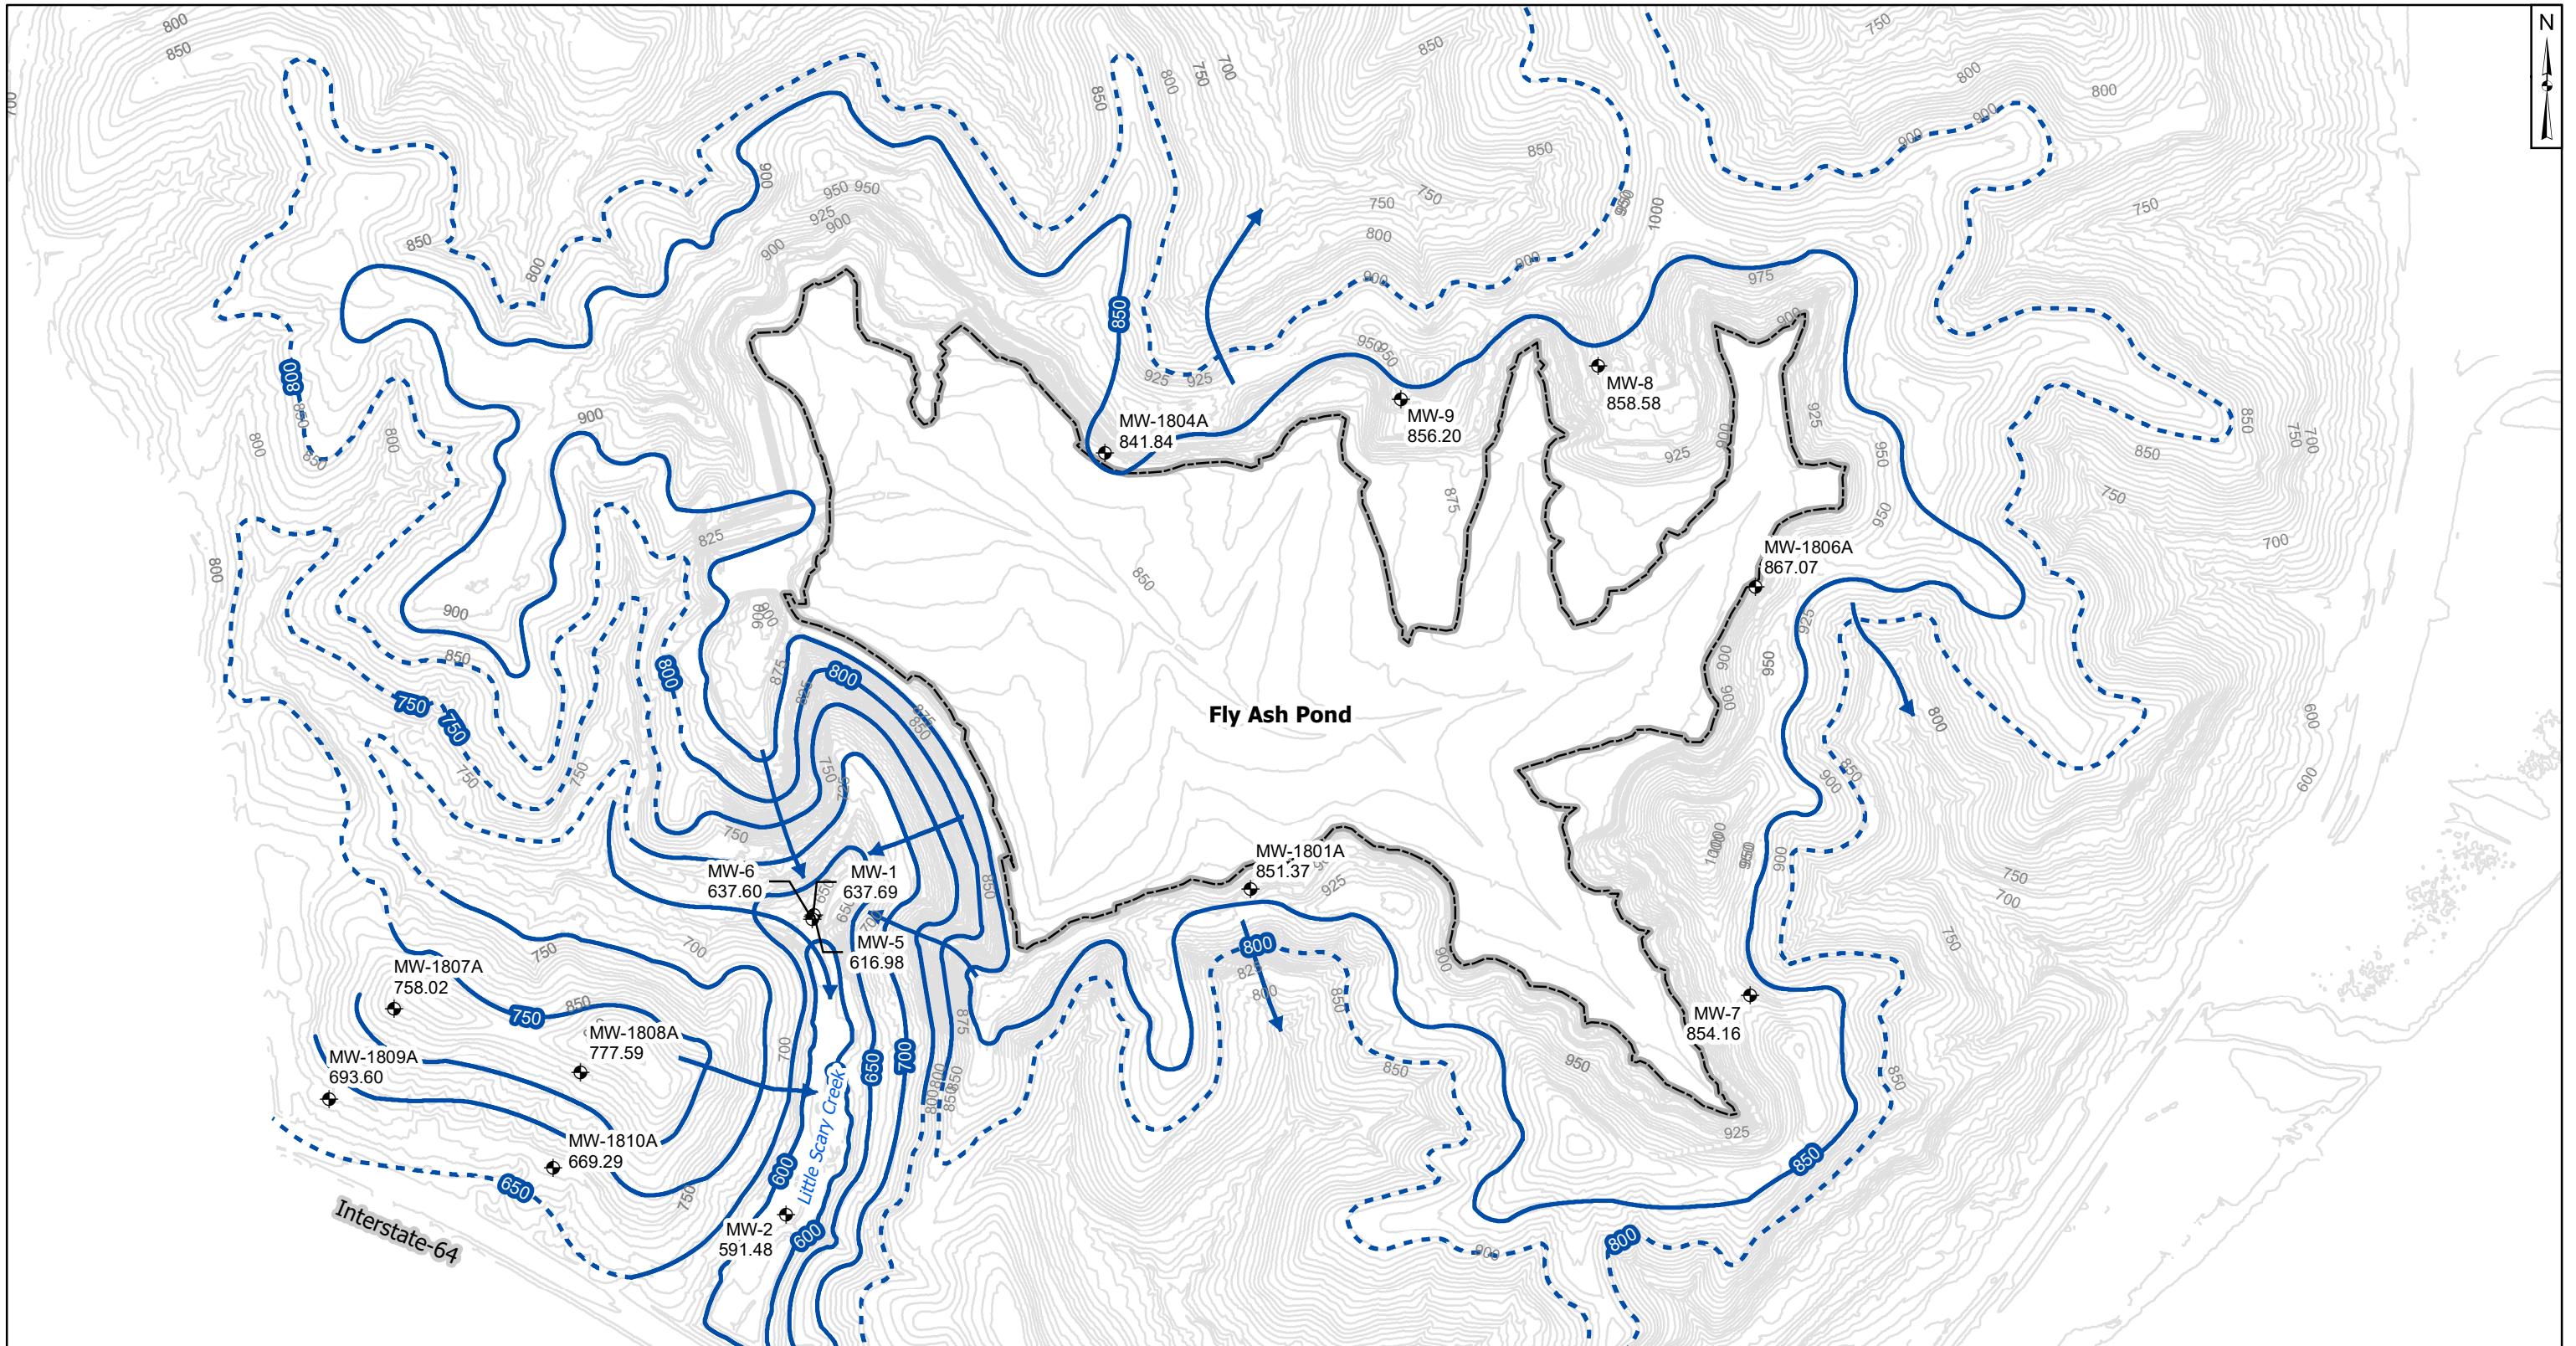

Legend

- Groundwater Monitoring Well
- Groundwater Flow Direction
- Groundwater Elevation Contour
- Groundwater Elevation Contour (Inferred)
- Fly Ash Pond

Notes

- Monitoring well coordinates and water level data (collected on May 31, 2023) provided by AEP.
- Potentiometric surface contour interval is 50 feet.
- Topography basemap from AEP Drawing No. 13-30705-0 (topographic contour interval: 10 feet).
- Site features based on information available in the Fly Ash Pond CCR Groundwater Monitoring Well Network Evaluation - Amos Plant report (Arcadis 2019) provided by AEP.
- Groundwater elevation units are in feet above mean sea level.



**Potentioetric Surface Map - Uppermost Aquifer
May 2023**



AEP Amos Generating Plant - Fly Ash Pond
Winfield, West Virginia

Geosyntec
consultants

Figure
2

Columbus, Ohio

2023/10/26

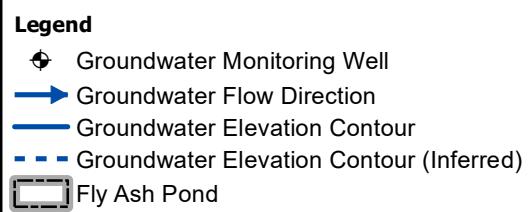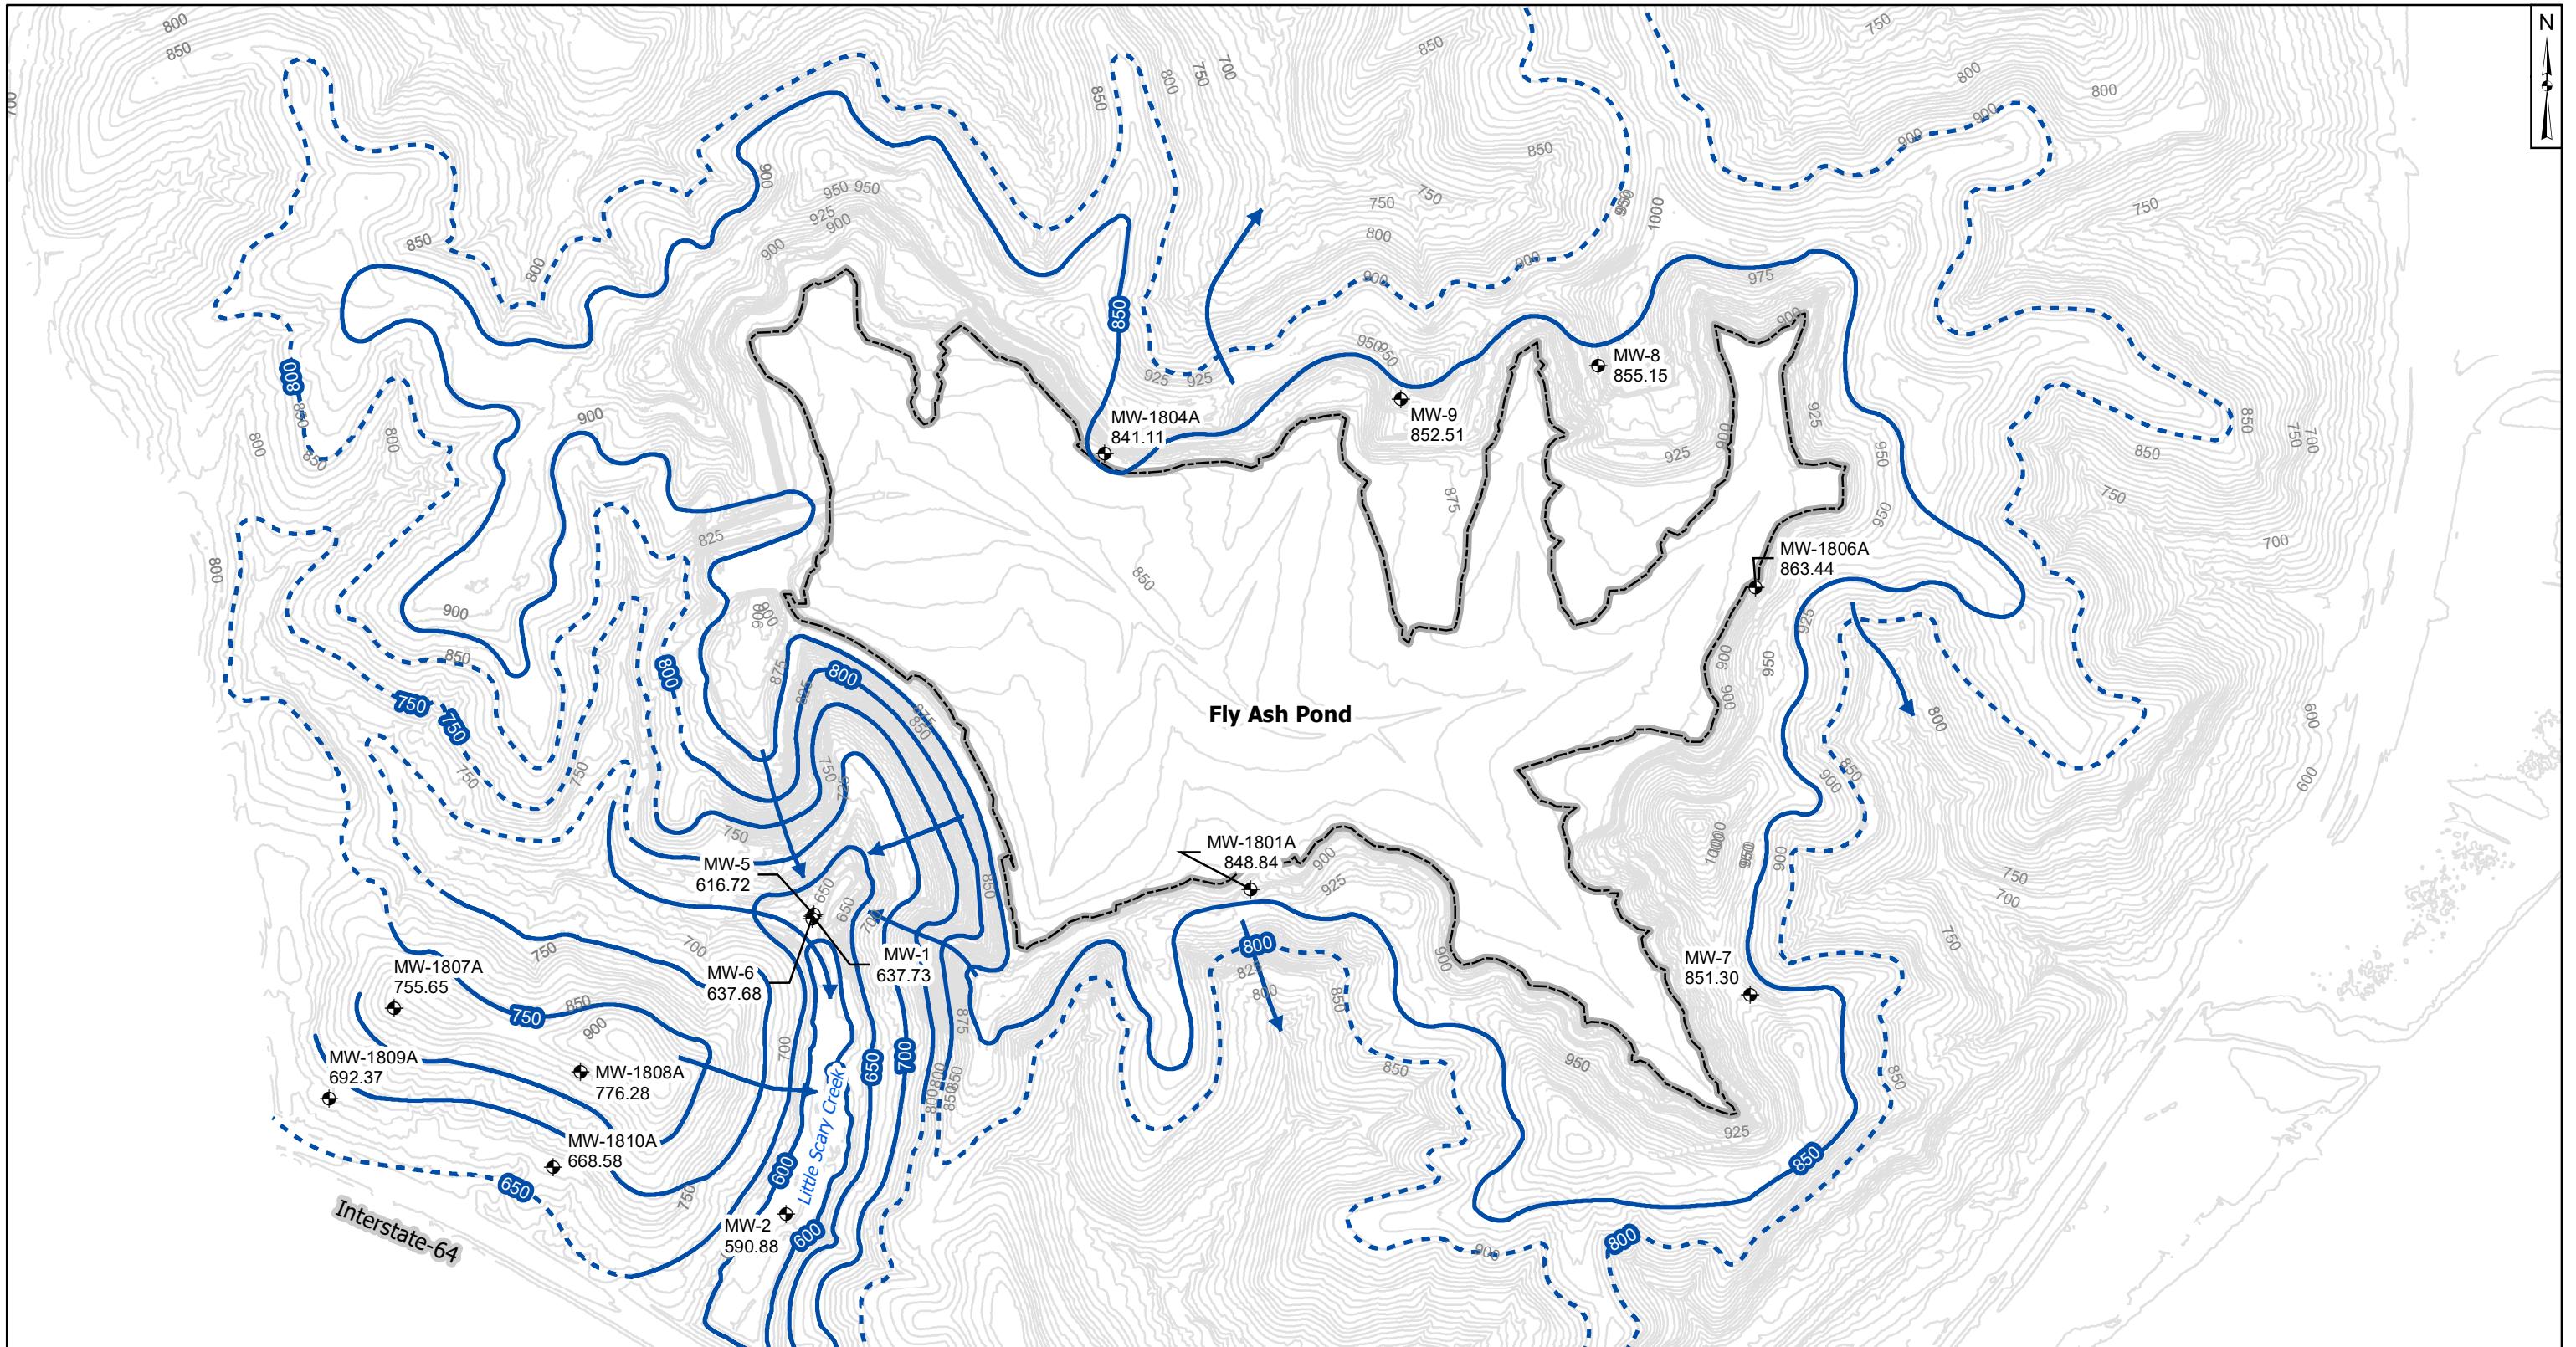

Notes

- Monitoring well coordinates and water level data (collected on October 16, 2023) provided by AEP.
- Potentiometric surface contour interval is 50 feet.
- Topography basemap from AEP Drawing No. 13-30705-0 (topographic contour interval: 10 feet).
- Site features based on information available in the Fly Ash Pond CCR Groundwater Monitoring Well Network Evaluation - Amos Plant report (Arcadis 2019) provided by AEP.
- Groundwater elevation units are in feet above mean sea level.



Potentiometric Surface Map - Uppermost Aquifer October 2023

AEP Amos Generating Plant - Fly Ash Pond
Winfield, West Virginia

Geosyntec
consultants

Figure

3

APPENDIX 2

The statistical analysis reports completed in 2023 follow.

Memorandum

Date: May 16, 2023

To: David Miller (AEP)

Copies to: Ben Kepchar (AEP)

From: Allison Kreinberg (Geosyntec)

Subject: Evaluation of Detection Monitoring Data at
Amos Plant's Fly Ash Pond (FAP)

In accordance with the United States Environmental Protection Agency's (USEPA's) regulations regarding the disposal of coal combustion residuals (CCR) in landfills and surface impoundments (40 CFR 257 Subpart D, "CCR rule"), the second semiannual detection monitoring event of 2022 at the Fly Ash Pond (FAP), an existing inactive CCR unit at the Amos Power Plant located in Winfield, West Virginia, was completed on October 25-27, 2022. Based on these results, verification sampling was completed on February 7, 2023.

Background values for the FAP were established in March 2020. After a minimum of four subsequent detection monitoring events, the results of those events were compared to the existing background dataset, and the background dataset was updated as appropriate. Revised upper prediction limits (UPLs) were calculated for each Appendix III parameter to represent background values. Lower prediction limits (LPLs) were also calculated for pH. Details on the calculation of these revised background values are described in Geosyntec's *Statistical Analysis Summary* report, dated December 28, 2021.

To achieve an acceptably high statistical power while maintaining a site-wide false-positive rate (SWFPR) of 10% per year or less, prediction limits were calculated based on a one-of-two retesting procedure. With this procedure, a statistically significant increase (SSI) is concluded only if both samples in a series of two exceed the UPL (or are below the LPL for pH). In practice, if the initial result did not exceed the UPL, a second sample was not collected or analyzed.

Detection monitoring results and the relevant background values are compared in Table 1. No SSIs were observed at the Amos FAP CCR unit, and as a result the Amos FAP will remain in detection monitoring.

Evaluation of Detection Monitoring Data – Amos FAP

May 16, 2023

Page 2

The statistical analysis was conducted within 90 days of completion of sampling and analysis in accordance with 40 CFR 257.93(h)(2). A certification of these statistics by a qualified professional engineer is provided in Attachment A.

Table 1. Detection Monitoring Data Evaluation
Detection Summary Memorandum
Amos Plant, Fly Ash Pond

Analyte	Unit	Description	MW-1	MW-2		MW-5	MW-6	MW-7	MW-8	MW-9	MW-1801A	MW-1804A	MW-1806A
			10/26/2022	10/26/2022	2/7/2023	10/26/2022	10/27/2022	10/25/2022	10/26/2022	10/25/2022	10/27/2022	10/27/2022	10/27/2022
Boron	mg/L	Intrawell Background Value (UPL)	0.153	0.348		0.331	0.137	0.146	0.296	0.174	0.388	0.912	0.214
		Analytical Result	0.106	0.220	--	0.201	0.073	0.065	0.192	0.135	0.137	0.759	0.138
Calcium	mg/L	Intrawell Background Value (UPL)	3.25	4.79		21.0	67.8	2.08	2.91	1.55	72.0	19.2	17.5
		Analytical Result	2.53	5.18	4.65	10.2	53.7	1.84	2.34	1.07	59.0	6.04	3.48
Chloride	mg/L	Intrawell Background Value (UPL)	14.6	489		880	21.2	5.67	116	7.95	11.8	16.4	19.3
		Analytical Result	10.5	450	--	781	15.7	5.44	108	7.15	8.15	7.39	11.5
Fluoride	mg/L	Intrawell Background Value (UPL)	0.521	3.43		3.76	0.324	0.325	3.20	0.970	0.165	1.07	1.13
		Analytical Result	0.46	3.06	--	3.28	0.26	0.28	3.03	0.87	0.10	0.79	0.87
pH	SU	Intrawell Background Value (UPL)	8.6	8.9		8.3	7.2	9.2	9.4	10.7	8.3	8.5	9.4
		Intrawell Background Value (LPL)	7.9	8.1		7.8	6.5	8.2	7.2	6.6	6.4	7.3	7.3
		Analytical Result	8.3	8.5	--	8.2	7.0	8.7	8.5	9.1	7.4	8.3	8.9
Sulfate	mg/L	Intrawell Background Value (UPL)	35.1	24.4		59.1	49.8	33.2	38.5	30.9	59.9	108	56.7
		Analytical Result	34.2	14.9	--	1.3	39.9	32.5	21.7	14.3	38.3	49.2	38.4
Total Dissolved Solids	mg/L	Intrawell Background Value (UPL)	483	1,380		2,000	429	422	756	529	442	600	488
		Analytical Result	430	1,320	--	1,770	360	400	700	450	350	520	440

Notes:

Bold values exceed the background value.

Background values are shaded gray.

UPL: Upper prediction limit

LPL: Lower prediction limit

mg/L: milligrams per liter

SU: standard units

--: not measured

ATTACHMENT A

Certification by a Qualified Professional Engineer

CERTIFICATION BY QUALIFIED PROFESSIONAL ENGINEER

I certify that the selected statistical method, described above and in the December 28, 2021 *Statistical Analysis Summary* report, is appropriate for evaluating the groundwater monitoring data for the Amos FAP CCR management area and that the requirements of 40 CFR 257.93(f) have been met.

David Anthony Miller

Printed Name of Licensed Professional Engineer

David A. Miller

Signature

22663
License Number

West Virginia
Licensing State

05.18.2023
Date



Memorandum

Date: October 5, 2023

To: David Miller (AEP)

Copies to: Marie Gildow (AEP)

From: Allison Kreinberg (Geosyntec)

Subject: Evaluation of Detection Monitoring Data at
Amos Plant's Fly Ash Pond (FAP)

In accordance with United States Environmental Protection Agency (USEPA) regulations regarding the disposal of coal combustion residuals (CCR) in landfills and surface impoundments (40 CFR 257 Subpart D, “CCR rule”), the first semiannual detection monitoring event of 2023 at the Fly Ash Pond (FAP), an existing inactive CCR unit at the Amos Power Plant located in Winfield, West Virginia, was completed on May 31-June 2, 2023. Based on these results, verification sampling was completed on July 18, 2023.

Background values for the FAP were established in March 2020. After a minimum of four subsequent detection monitoring events, the results of those events were compared to the existing background dataset, and the background dataset was updated as appropriate. Revised upper prediction limits (UPLs) were calculated for each Appendix III parameter to represent background values. Lower prediction limits (LPLs) were also calculated for pH. Details on the calculation of these revised background values are described in Geosyntec’s *Statistical Analysis Summary* report, dated December 28, 2021.

To achieve an acceptably high statistical power while maintaining a site-wide false-positive rate (SWFPR) of 10% per year or less, prediction limits were calculated based on a one-of-two retesting procedure. With this procedure, a statistically significant increase (SSI) is concluded only if both samples in a series of two exceed the UPL (or are below the LPL for pH). In practice, if the initial result did not exceed the UPL, a second sample was not collected or analyzed.

Detection monitoring results and the relevant background values are compared in Table 1. No SSIs were observed at the Amos FAP CCR unit, and as a result the Amos FAP will remain in detection monitoring.

Evaluation of Detection Monitoring Data – Amos FAP

October 5, 2023

Page 2

The statistical analysis was conducted within 90 days of completion of sampling and analysis in accordance with 40 CFR 257.93(h)(2). A certification of these statistics by a qualified professional engineer is provided in Attachment A.

Table 1: Detection Monitoring Data Evaluation
Amos Plant - Fly Ash Pond

Geosyntec Consultants, Inc.

Analyte	Unit	Description	MW-1	MW-2		MW-5	MW-6	MW-7	MW-8	MW-9	MW-1801A	MW-1804A	MW-1806A
			6/1/2023	6/2/2023	7/18/2023	5/31/2023	5/31/2023	6/1/2023	6/1/2023	6/2/2023	6/1/2023	6/1/2023	6/1/2023
Boron	mg/L	Intrawell Background Value (UPL)	0.153	0.348		0.331	0.137	0.146	0.296	0.174	0.388	0.912	0.214
		Analytical Result	0.107	0.20	--	0.173	0.070	0.05	0.17	0.12	0.068	0.72	0.12
Calcium	mg/L	Intrawell Background Value (UPL)	3.25	4.79		21.0	67.8	2.08	2.91	1.55	72.0	19.2	17.5
		Analytical Result	2.25	4.73	--	7.07	46.8	1.61	2.12	1.07	62.3	5.18	3.04
Chloride	mg/L	Intrawell Background Value (UPL)	14.6	489		880	21.2	5.67	116	7.95	11.8	16.4	19.3
		Analytical Result	10.4	454	--	703	13.7	5.40	107	7.26	7.65	10.4	13.1
Fluoride	mg/L	Intrawell Background Value (UPL)	0.521	3.43		3.76	0.324	0.325	3.20	0.970	0.165	1.07	1.13
		Analytical Result	0.47	3.16	--	3.18	0.28	0.24	2.95	0.88	0.08	0.82	0.87
pH	SU	Intrawell Background Value (UPL)	8.6	8.9		8.3	7.2	9.2	9.4	10.7	8.3	8.5	9.4
		Intrawell Background Value (LPL)	7.9	8.1		7.8	6.5	8.2	7.2	6.6	6.4	7.3	7.3
		Analytical Result	8.1	7.5	8.4	7.9	6.8	8.4	8.3	8.9	7.0	7.9	8.8
		Intrawell Background Value (UPL)	35.1	24.4		59.1	49.8	33.2	38.5	30.9	59.9	108	56.7
Sulfate	mg/L	Analytical Result	32.9	4.5	--	19.2	36.6	30.9	22.3	14.3	32.7	58.1	40.5
		Intrawell Background Value (UPL)	483	1,380		2,000	429	422	756	529	442	600	488
Total Dissolved Solids	mg/L	Analytical Result	430	1,310	--	1,660	350	380	710	460	330	550	450

Notes:

Bold values exceed the background value.

Background values are shaded gray.

LPL: lower prediction limit

mg/L: milligrams per liter

SU: standard units

UPL: upper prediction limit

--: not sampled

ATTACHMENT A
Certification by a Qualified Professional Engineer

CERTIFICATION BY QUALIFIED PROFESSIONAL ENGINEER

I certify that the selected statistical method, described above and in the December 28, 2021 *Statistical Analysis Summary* report, is appropriate for evaluating the groundwater monitoring data for the Amos FAP CCR management area and that the requirements of 40 CFR 257.93(f) have been met.

David Anthony Miller

Printed Name of Licensed Professional Engineer

David Anthony Miller

Signature



22663
License Number

West Virginia
Licensing State

10.13.2023
Date

APPENDIX 3

Not Applicable.

APPENDIX 4

Not applicable.

APPENDIX 5

Not applicable.